



PLAN - 76th FL. - SS-75N

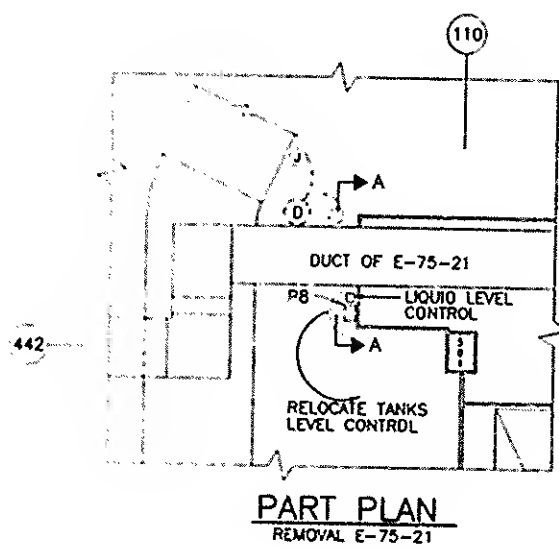

PART PLAN  
REMOVAL E-75-21

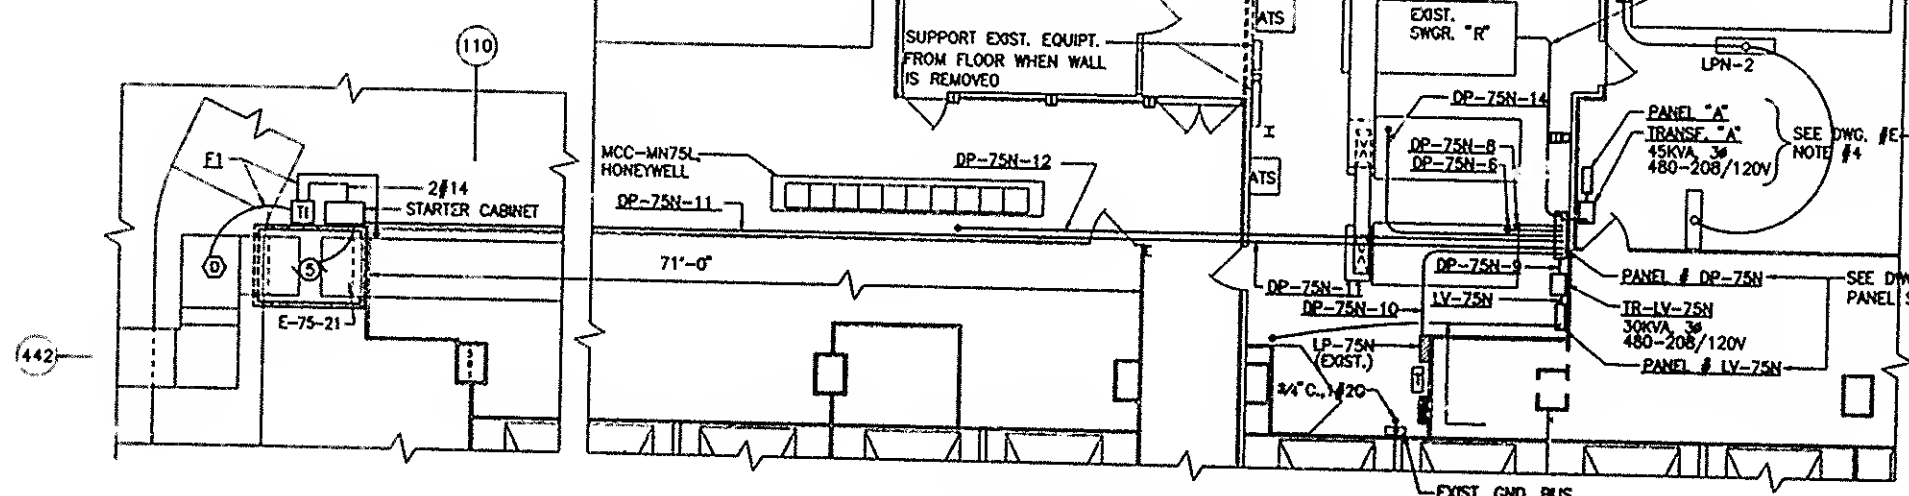

PLAN - 75th FL. - SS-75N

1. FOR LEGEND SEE DWG. #E-1 AND LIGHTING FIXTURE SCHEDULE
2. FOR TYPICAL SUBSTATION STATION DWG. #E-4.

3/4" C. 2#14 TO EL. CL. "C"  
3/4" C. EMPTY  
3/4" C. 4#14&5#18  
TO 41st FL. MER. (CRITICAL)

3/4" C. 4#14&(2-3#18)

PANEL "A" TRANSFORMER  
350KVA, 3P  
480-208/120V  
SEE DWG. #E-4, NOTE #4

PANEL # DP-75N  
IR-LV-75N  
30KVA, 3P  
480-208/120V  
PANEL # LV-75N  
SEE DWG. #E-101, PANEL SCHEDULES